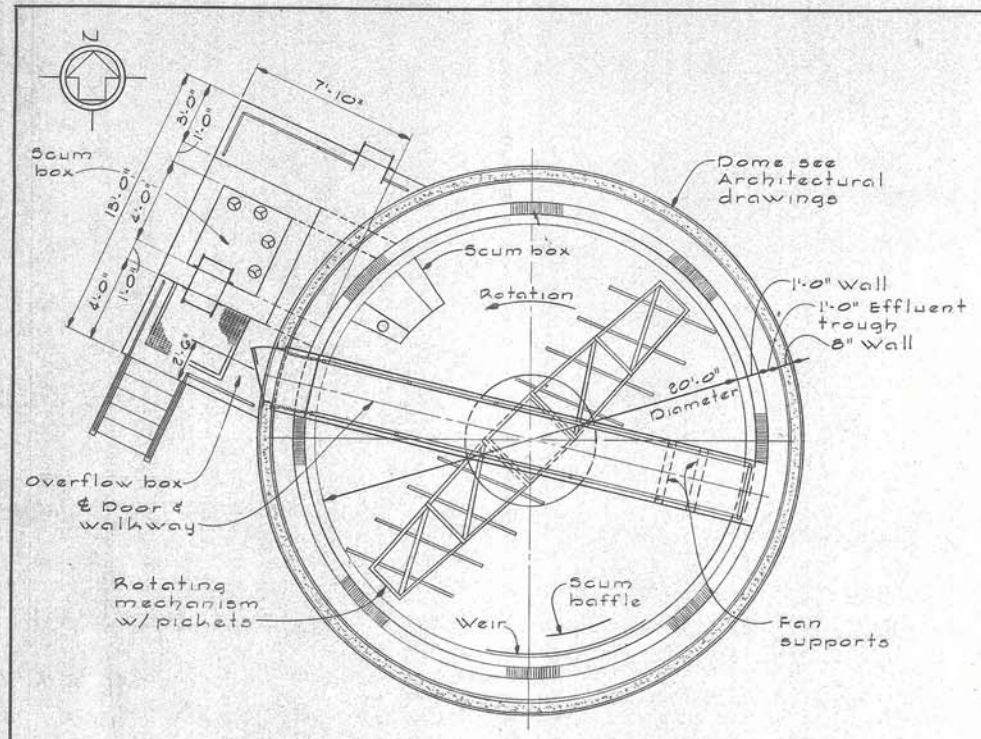

UPPER PLAN

THICKENER TANK No. 2

Scale: 1/4" = 1'-0"

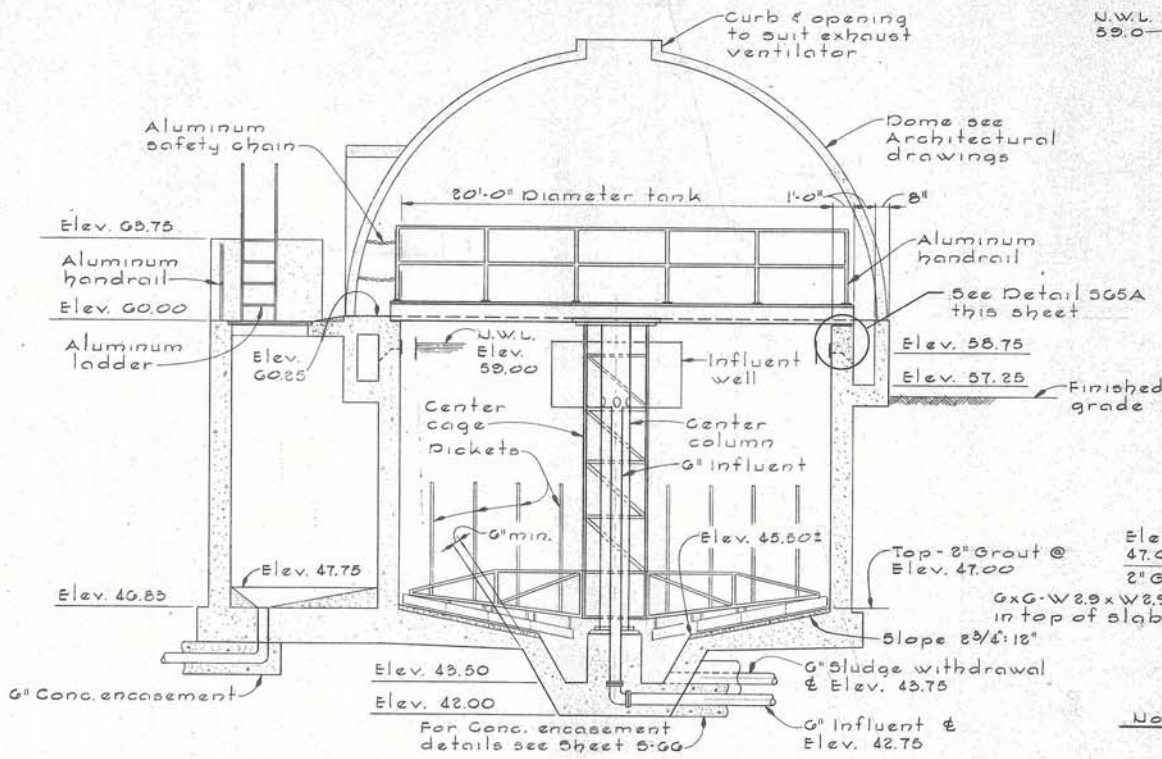

TYPICAL TANK SECTION

Scale: 1/4" = 1'-0"

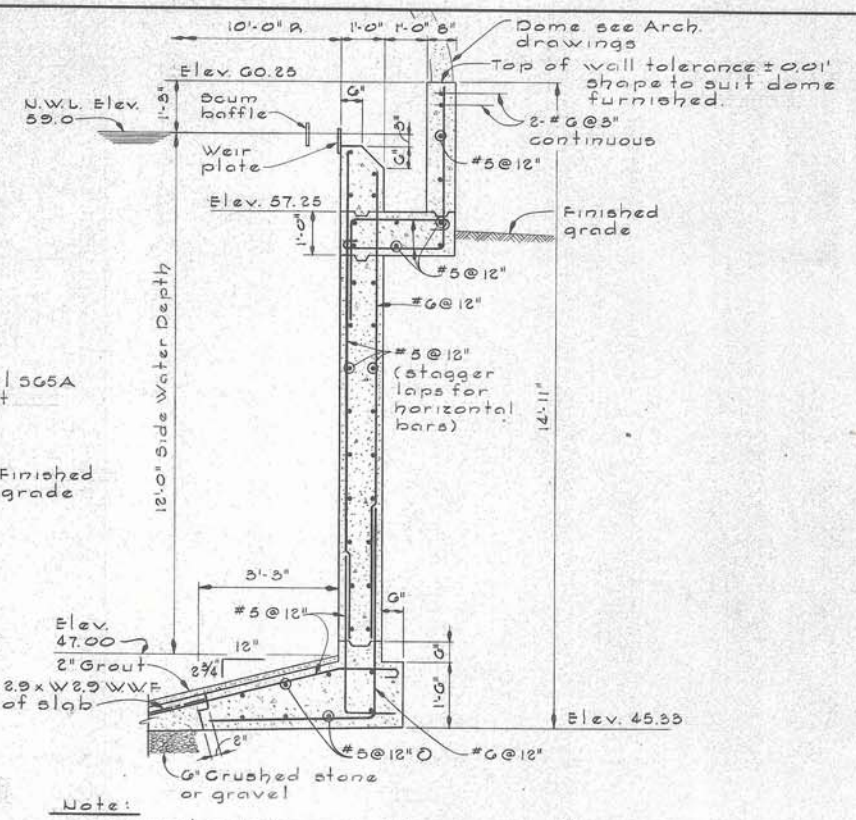

Note:

2" Grout in bottom shall be swept in place by use of mechanism. The mechanism shall not be driven by its own motor when screeding grout.

TYPICAL WALL SECTION

Scale: 1/2" = 1'-0"

Note:

1. Upper & lower plans shown for Thickener tank #2. Thickener tank #1 is opposite hand.
2. Inside of tank must be round to 20'-0" diameter ± 1 inch.

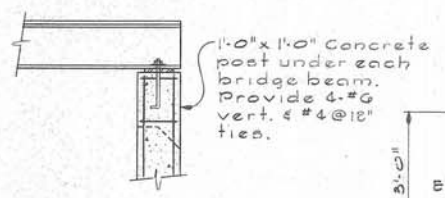

DETAIL 5G5A/5G5

Scale: 1/2" = 1'-0"

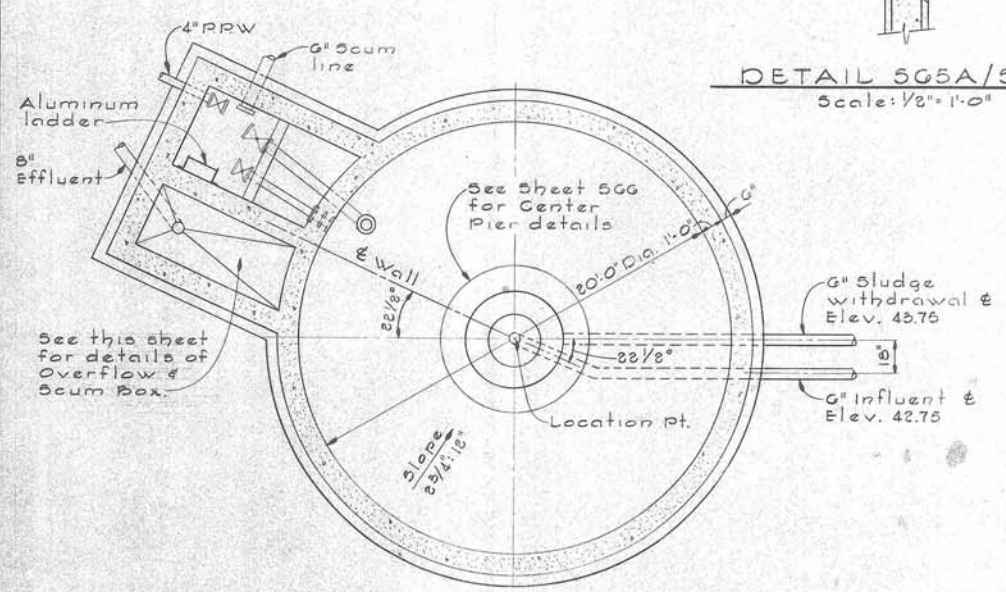

LOWER PLAN

THICKENER TANK No. 2

Scale: 1/4" = 1'-0"

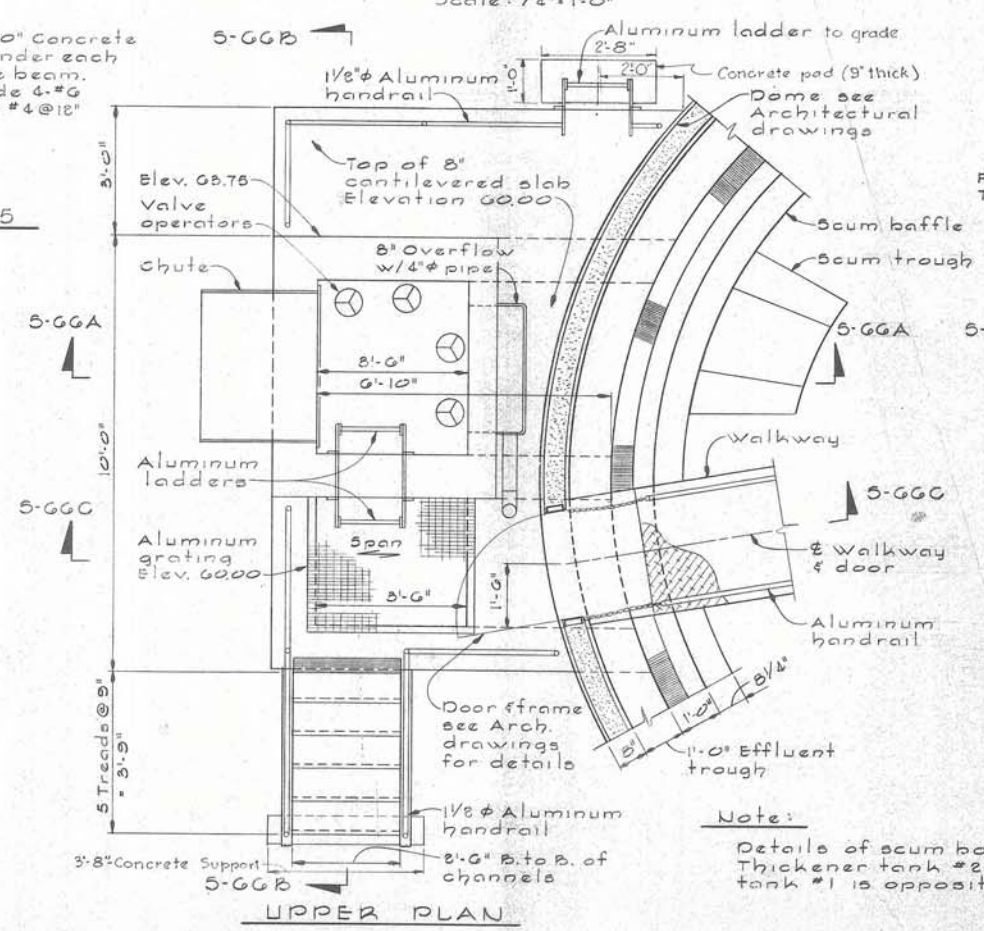

UPPER PLAN

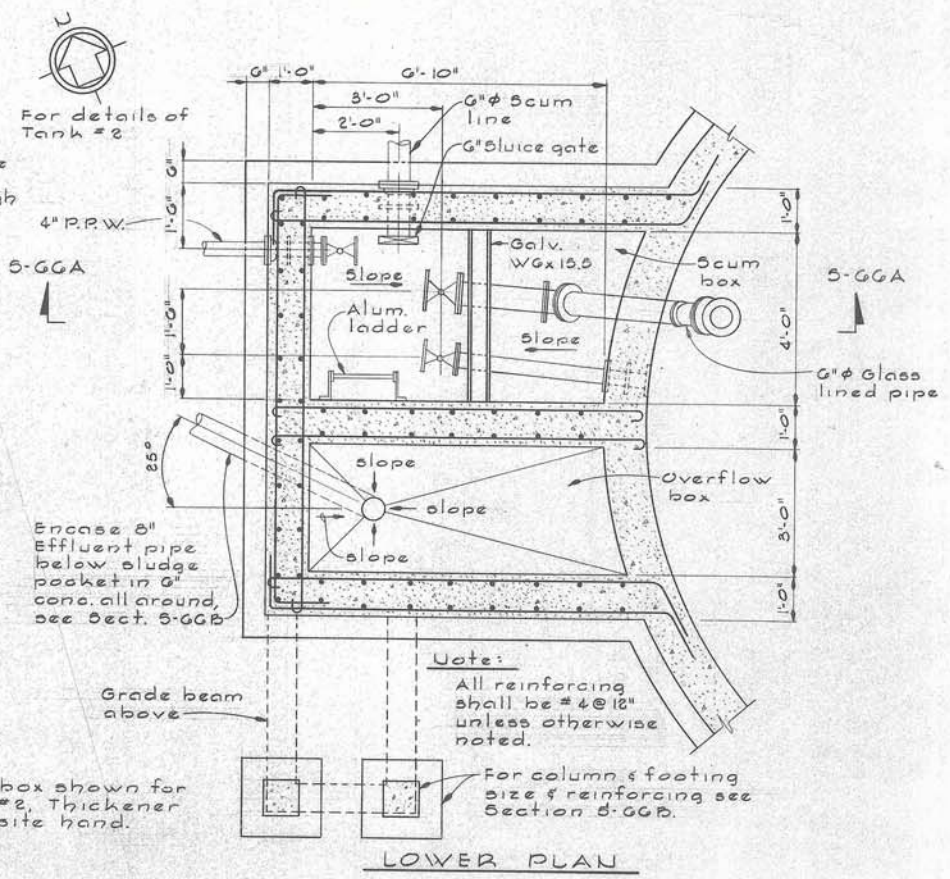

Note:

Details of scum box shown for Thickener tank #2, Thickener tank #1 is opposite hand.

Note:

All reinforcing shall be #4@12" unless otherwise noted.

LOWER PLAN

DETAILS OF SCUM BOX

Scale: 1/2" = 1'-0"

WHITMAN, REQUARDT & ASSOCIATES ENGINEERS BALTIMORE, MARYLAND	DESIGNED WMC DRAWN E.E.R CHECKED WMC	TOWN OF ABERDEEN MARYLAND	ADVANCED WASTEWATER TREATMENT PLANT	THICKENER TANKS PLANS, SECTIONS & DETAILS	GRAPHIC SCALE 1/4" = 1'-0" 1/2" = 1'-0"	REV.	DESCRIPTION	DATE	NAME	DATE DEC. 1977 / DRAWING NO. 112 / PROJECT NO. C-240346-01 / SHEET NO. S-65

W.O. 6680-2